




	STOP VALVE
	CHECK VALVE
	CIRCULATOR

SSH HEATER PIPED TO ONE STORAGE TANK

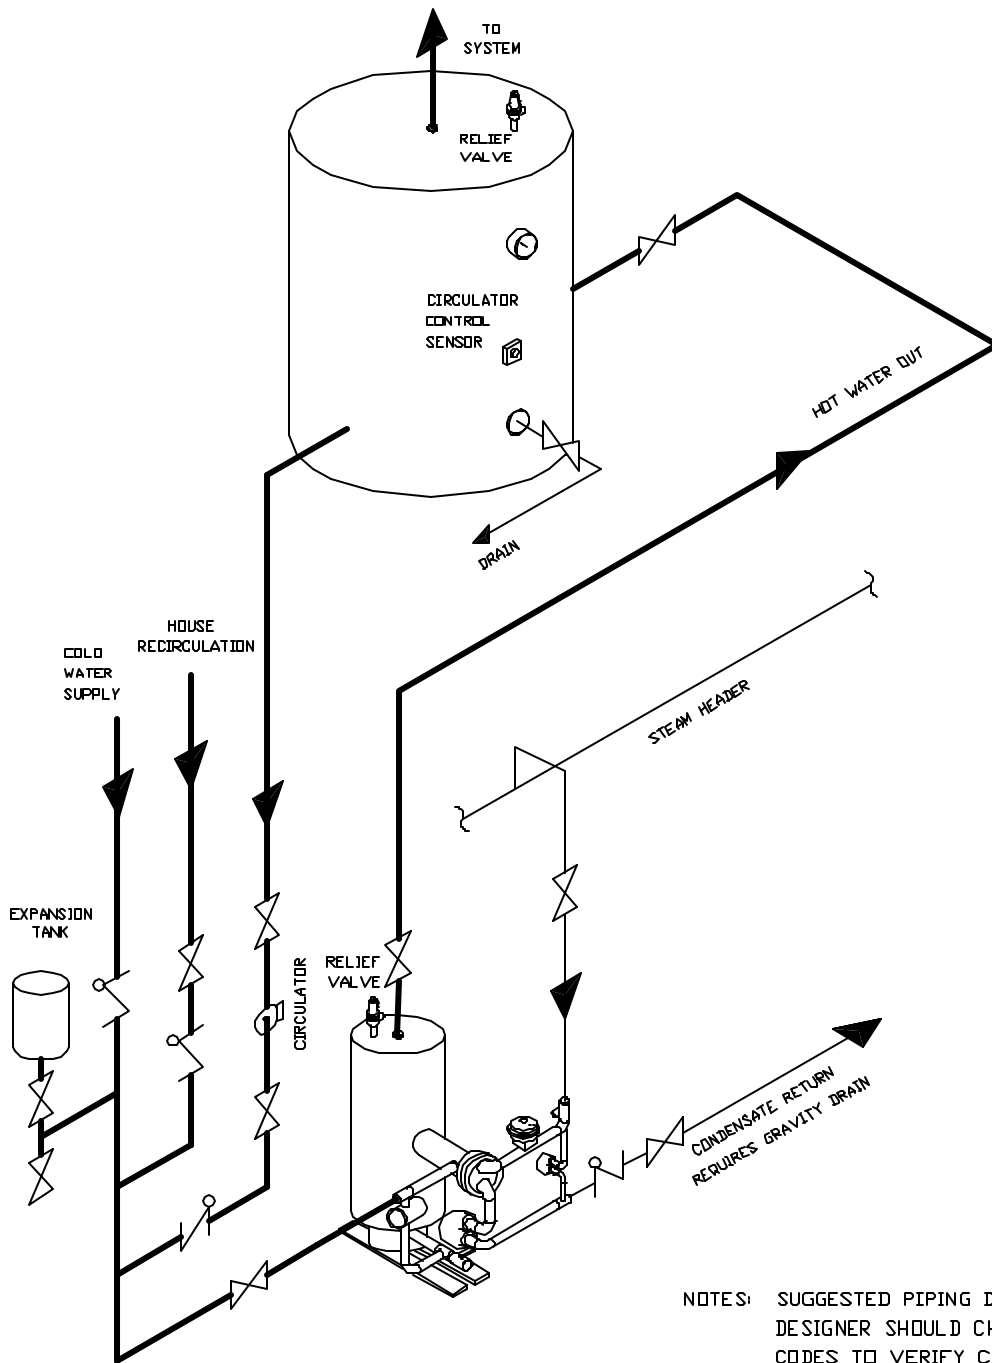

NOTES: SUGGESTED PIPING DESIGN.  
 DESIGNER SHOULD CHECK WITH LOCAL  
 CODES TO VERIFY COMPLIANCE.

PIPE ALL RELIEF VALVES TO DRAIN.