




TWO SEH HEATERS
PIPED IN PARALLEL TO
ONE STORAGE TANK

	STOP VALVE
	CHECK VALVE
	CIRCULATOR

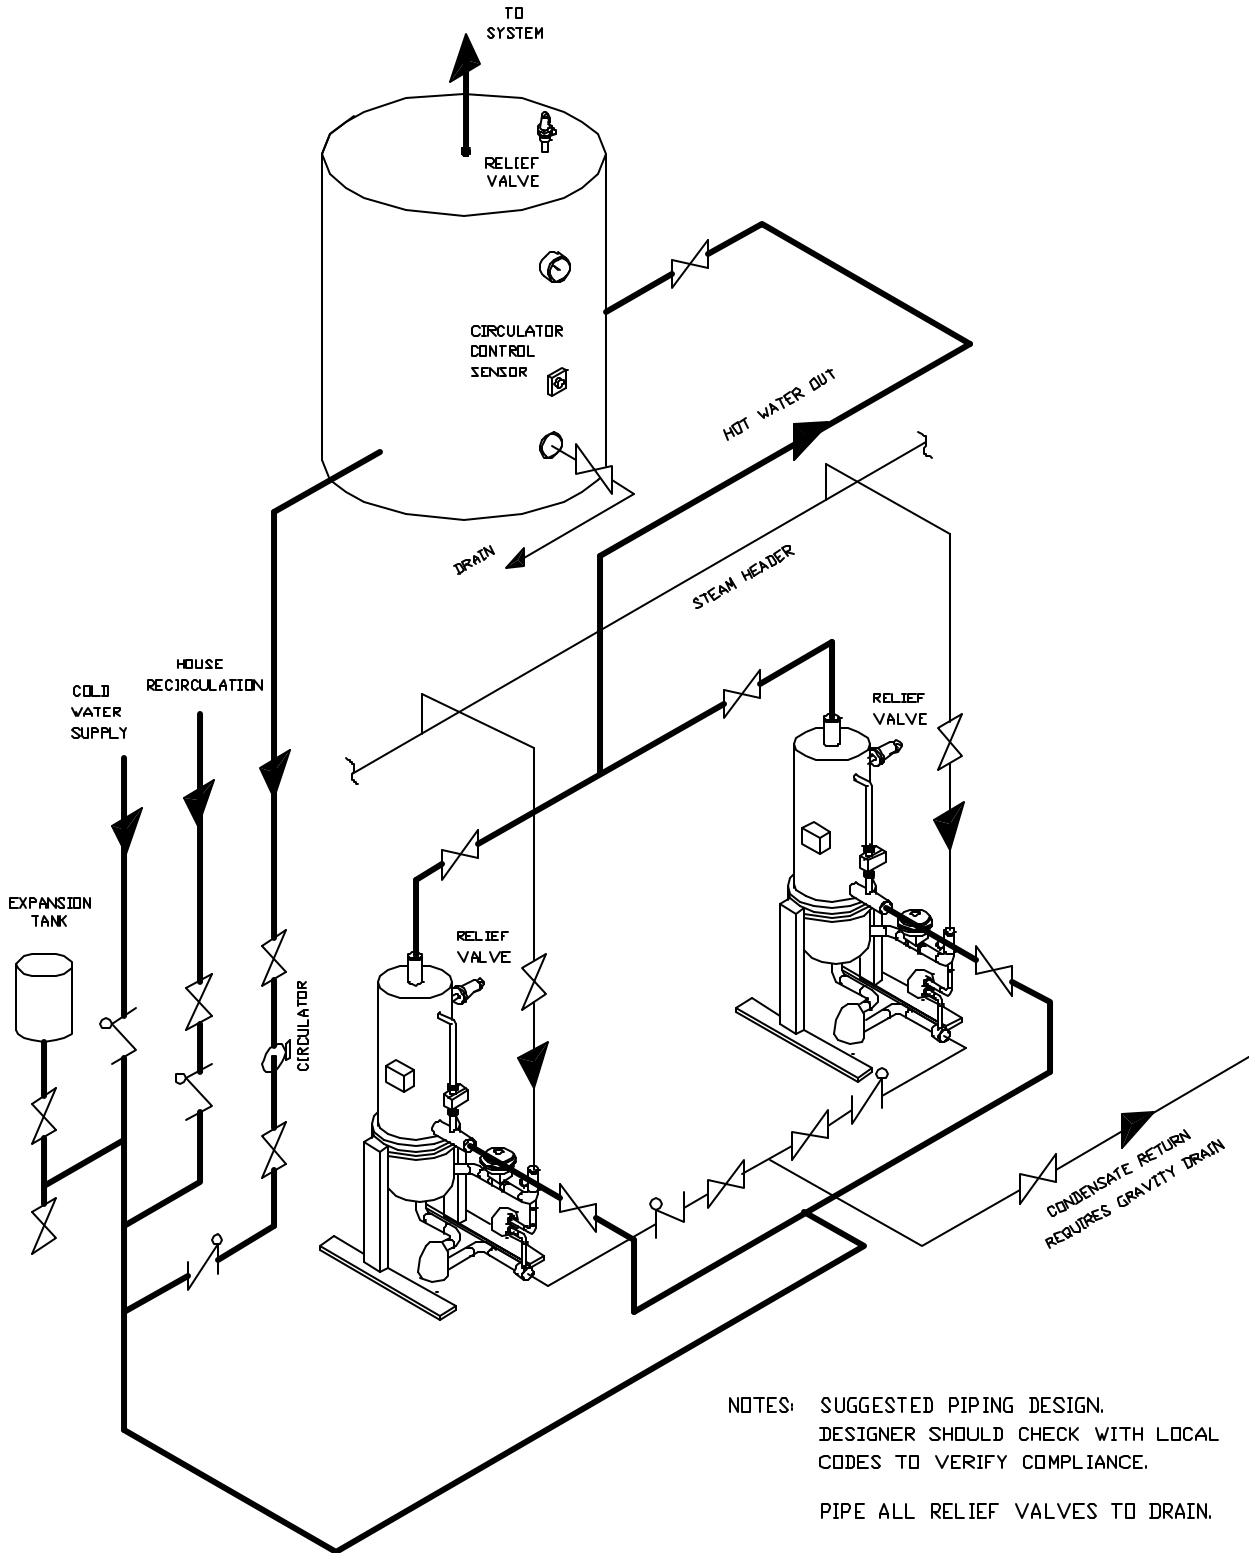

NOTES: SUGGESTED PIPING DESIGN.
DESIGNER SHOULD CHECK WITH LOCAL
CODES TO VERIFY COMPLIANCE.
PIPE ALL RELIEF VALVES TO DRAIN.