




TWO SEH HEATERS  
PARALLEL PIPED TO  
TWO STORAGE TANKS

	STOP VALVE
	CHECK VALVE
	CIRCULATOR

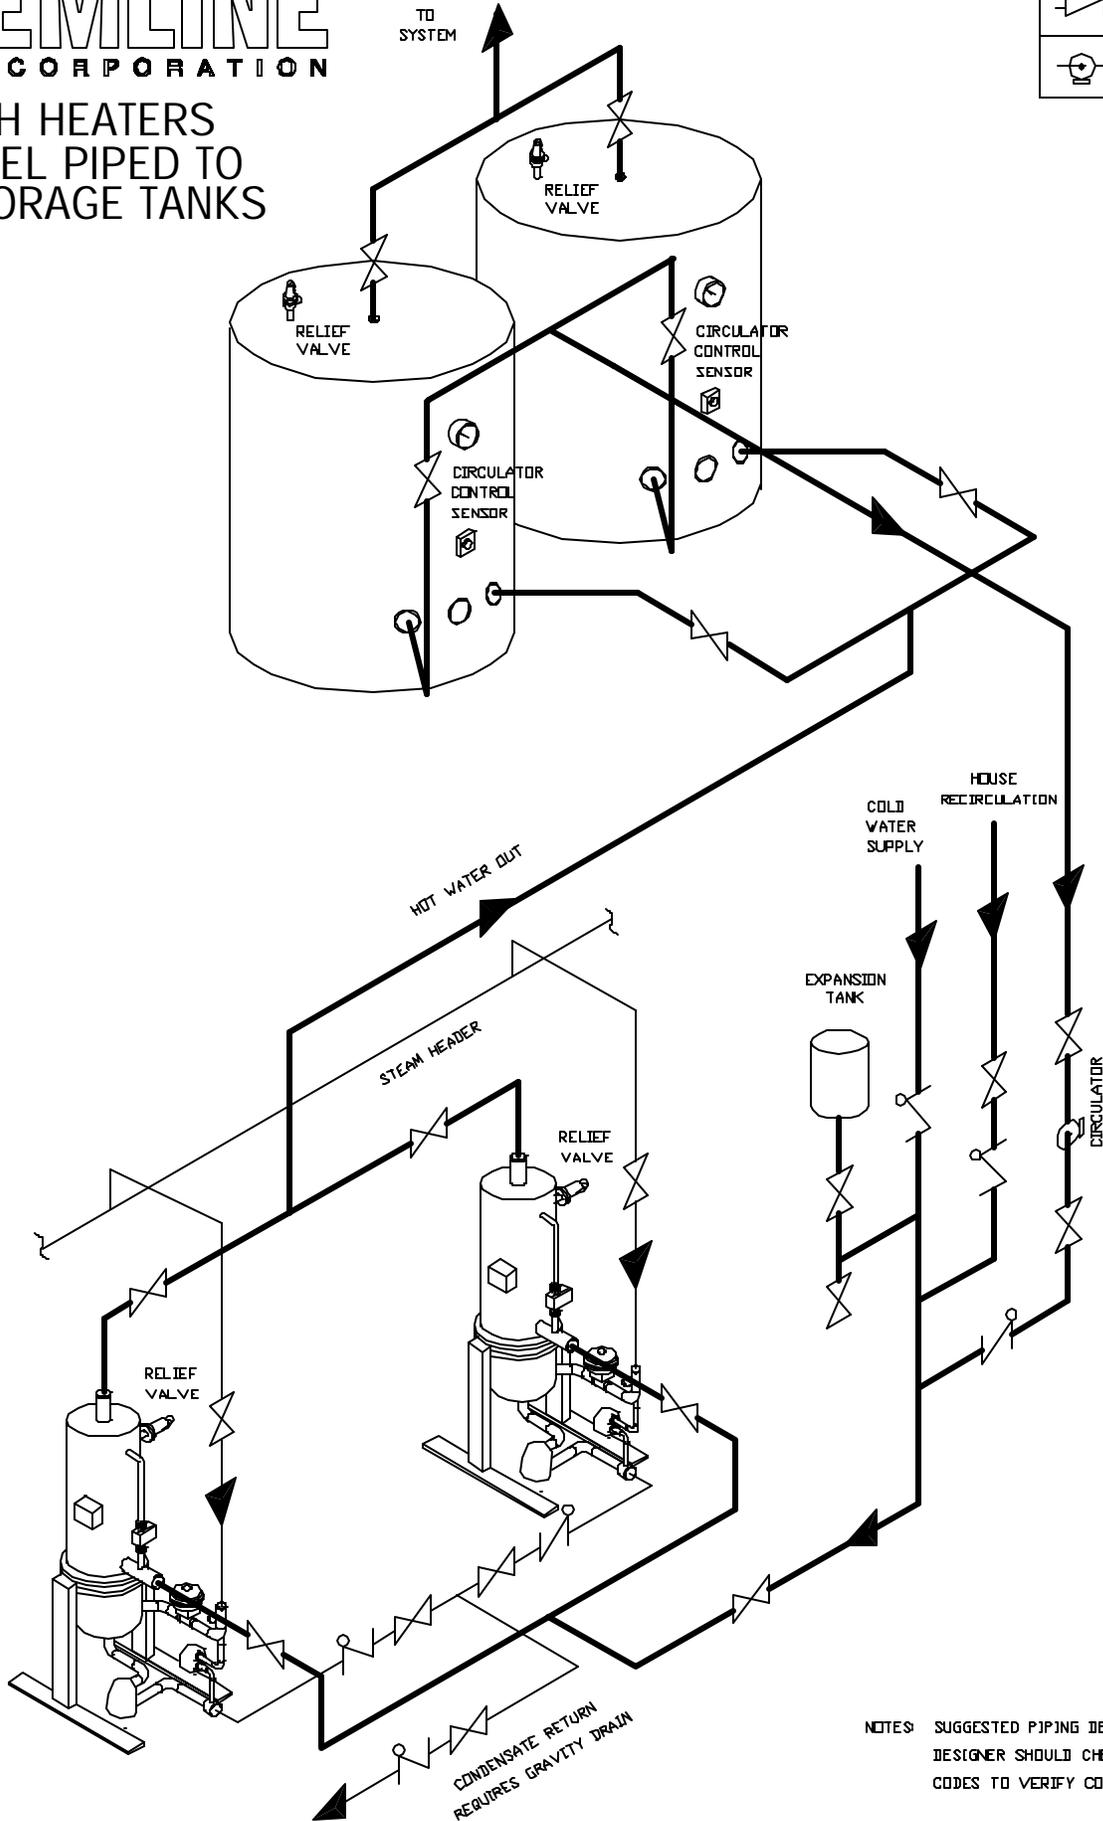

NOTES: SUGGESTED PIPING DESIGN  
DESIGNER SHOULD CHECK WITH LOCAL  
CODES TO VERIFY COMPLIANCE.

PIPE ALL RELIEF VALVES TO DRAIN