




ONE SSH HEATER PARALLEL PIPED TO TWO STORAGE TANKS

	STOP VALVE
	CHECK VALVE
	CIRCULATOR

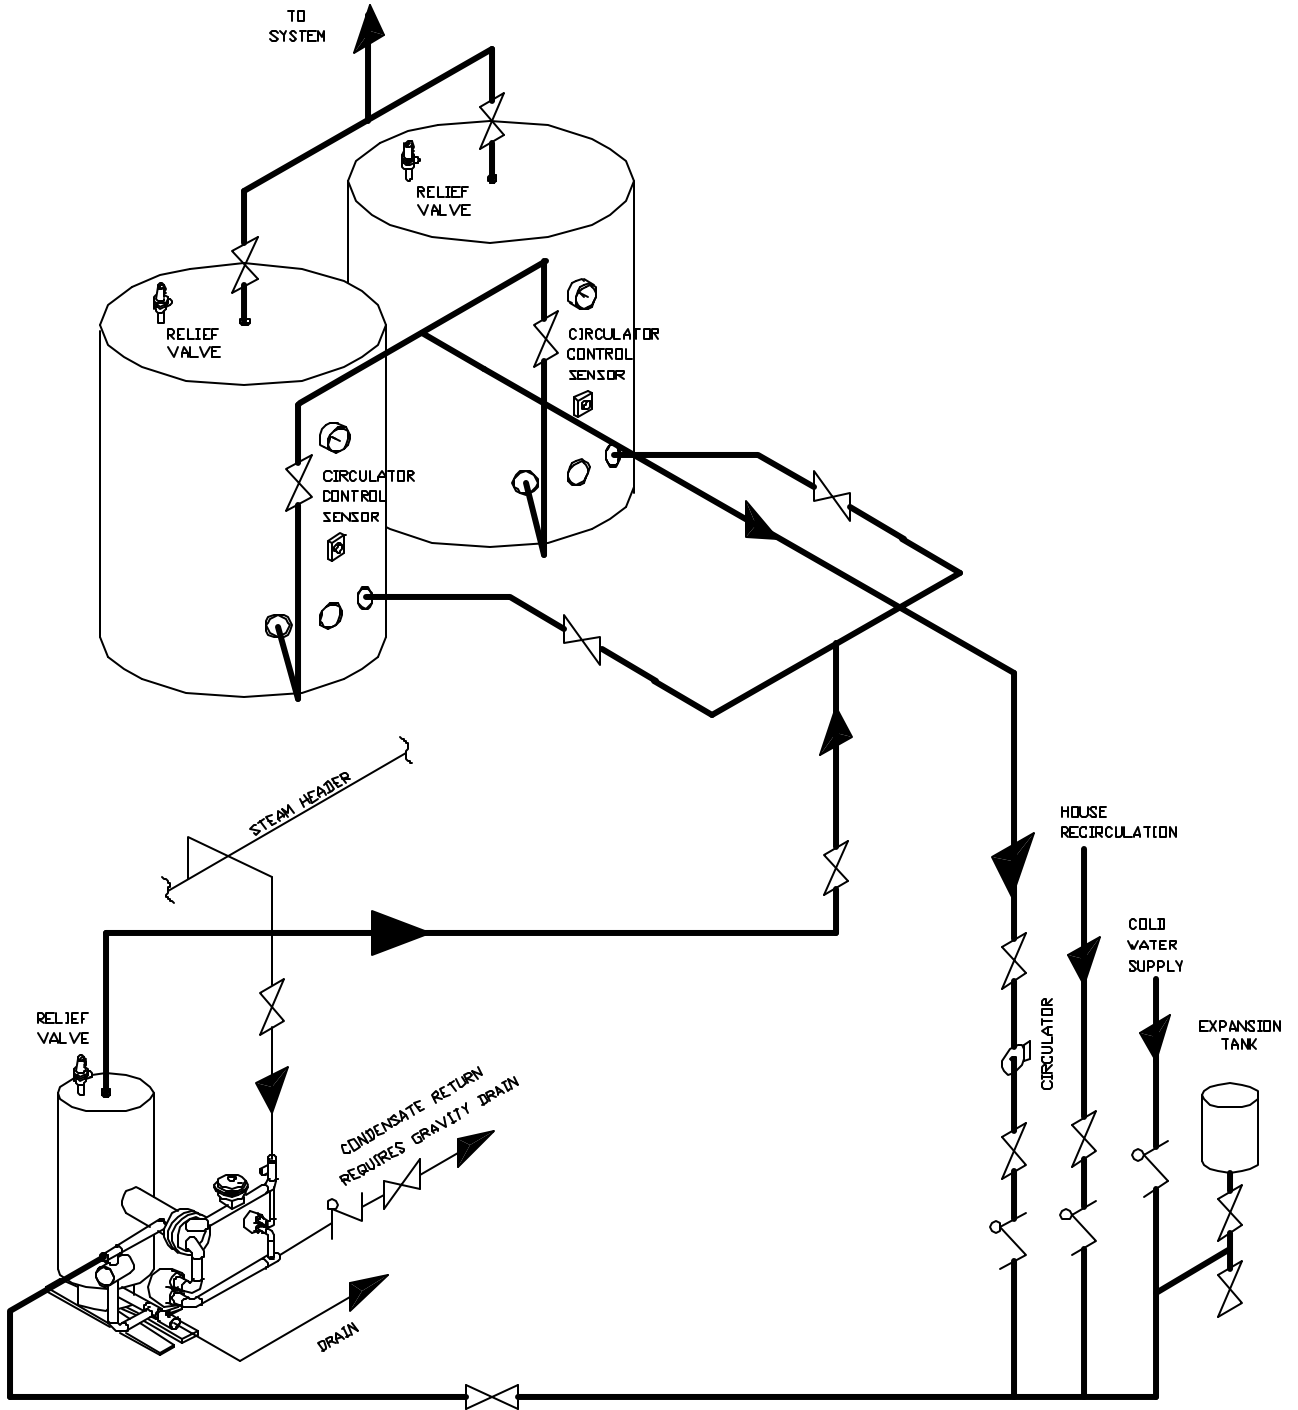

NOTES: SUGGESTED PIPING DESIGN.
 DESIGNER SHOULD CHECK WITH LOCAL
 CODES TO VERIFY COMPLIANCE.
 PIPE ALL RELIEF VALVES TO DRAIN