




|  |             |
|--|-------------|
|  | STOP VALVE  |
|  | CHECK VALVE |
|  | CIRCULATOR  |

# ONE SSH HEATER PARALLEL PIPED TO THREE STORAGE TANKS

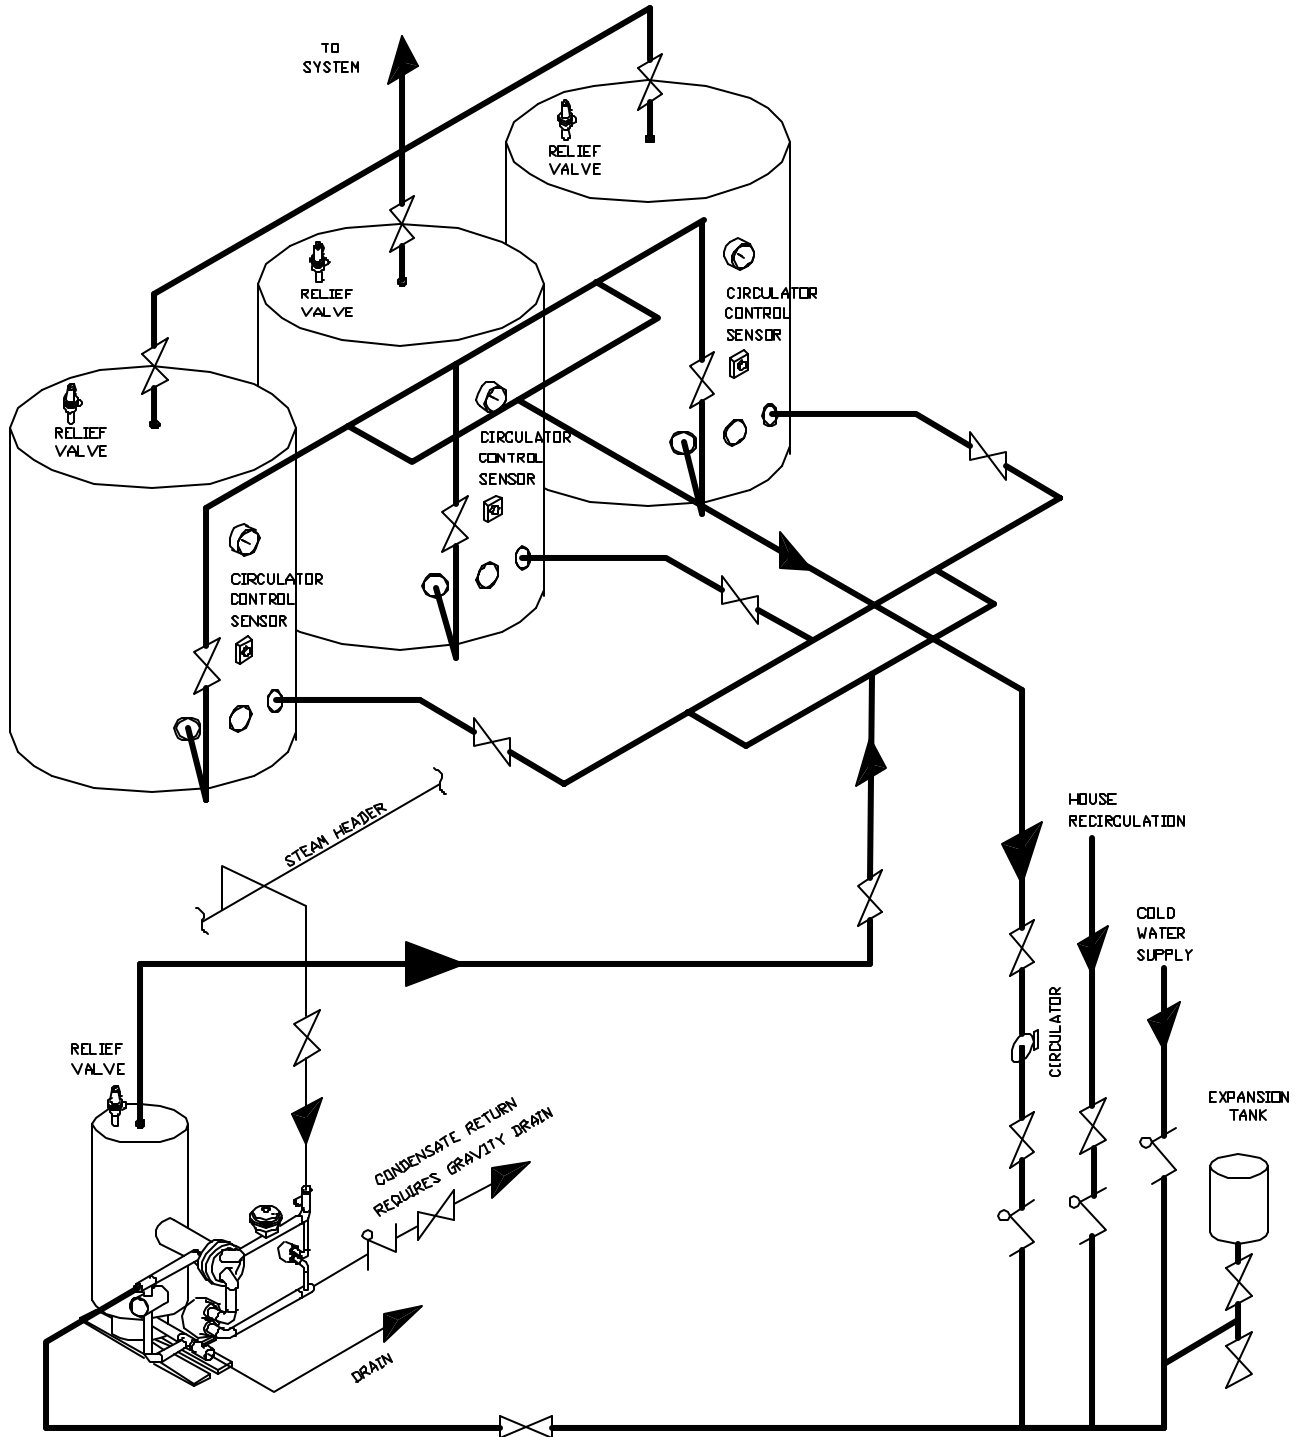

NOTE: SUGGESTED PIPING DESIGN.  
DESIGNER SHOULD CHECK WITH LOCAL  
CODES TO VERIFY COMPLIANCE.  
PIPE ALL RELIEF VALVES TO DRAIN